


ROCKY MOUNT PUBLIC UTILITIES

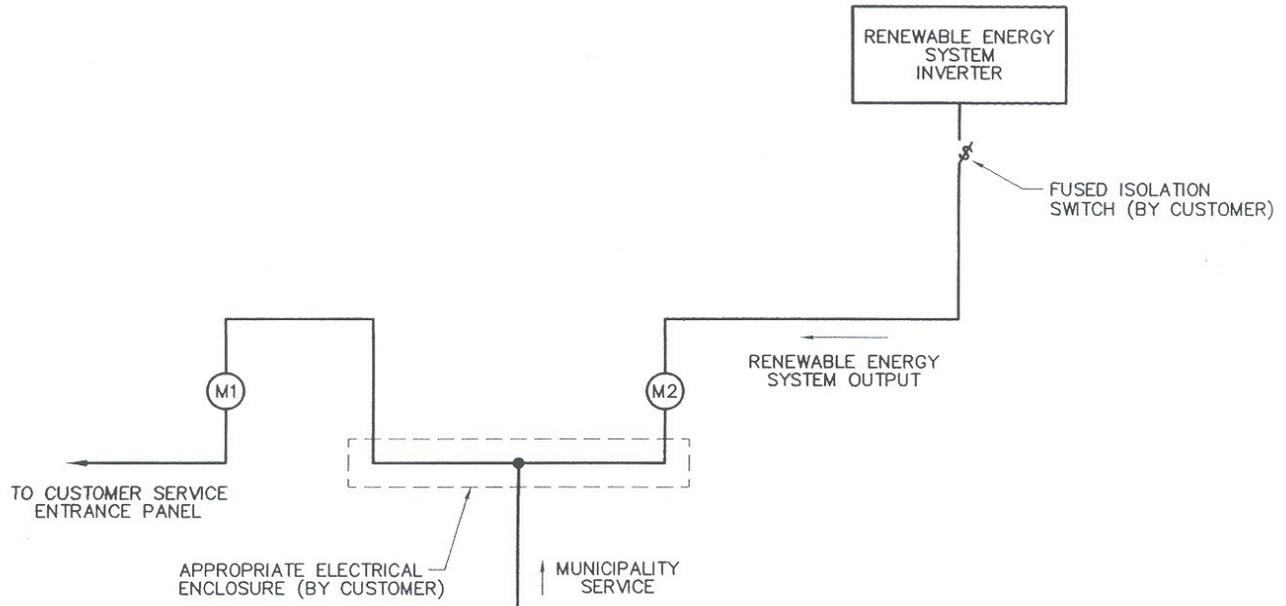

NOTES:

1. SYSTEM SHALL NOT ENERGIZE A DEAD BUSS SYSTEM.
2. M1 IS THE METER FOR THE RESIDENTIAL SERVICE.
3. M2 IS THE METER FOR THE RENEWABLE ENERGY INPUT TO THE SYSTEM.
4. INVERTER/ISOLATION SYSTEM TO BE UL 1741 LISTED AND INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NFPA 70).
5. THE ISOLATION BY THE CUSTOMER TO BE SIZED PER NATIONAL ELECTRIC CODE MINIMUM SIZE = 100 AMPS. SWITCH SHALL BE LOCKABLE IN THE OPEN POSITION.

3				RENEWABLE ENERGY INTERCONNECTION INSTALLATION-- DIAGRAM FOR SYSTEMS LESS THAN 20 KW CAPACITY	SCALE NOT TO SCALE
2					
1					
0	7/23/07	CADD GRAPHICS	OST		
REVISED	BY	APPR.			